
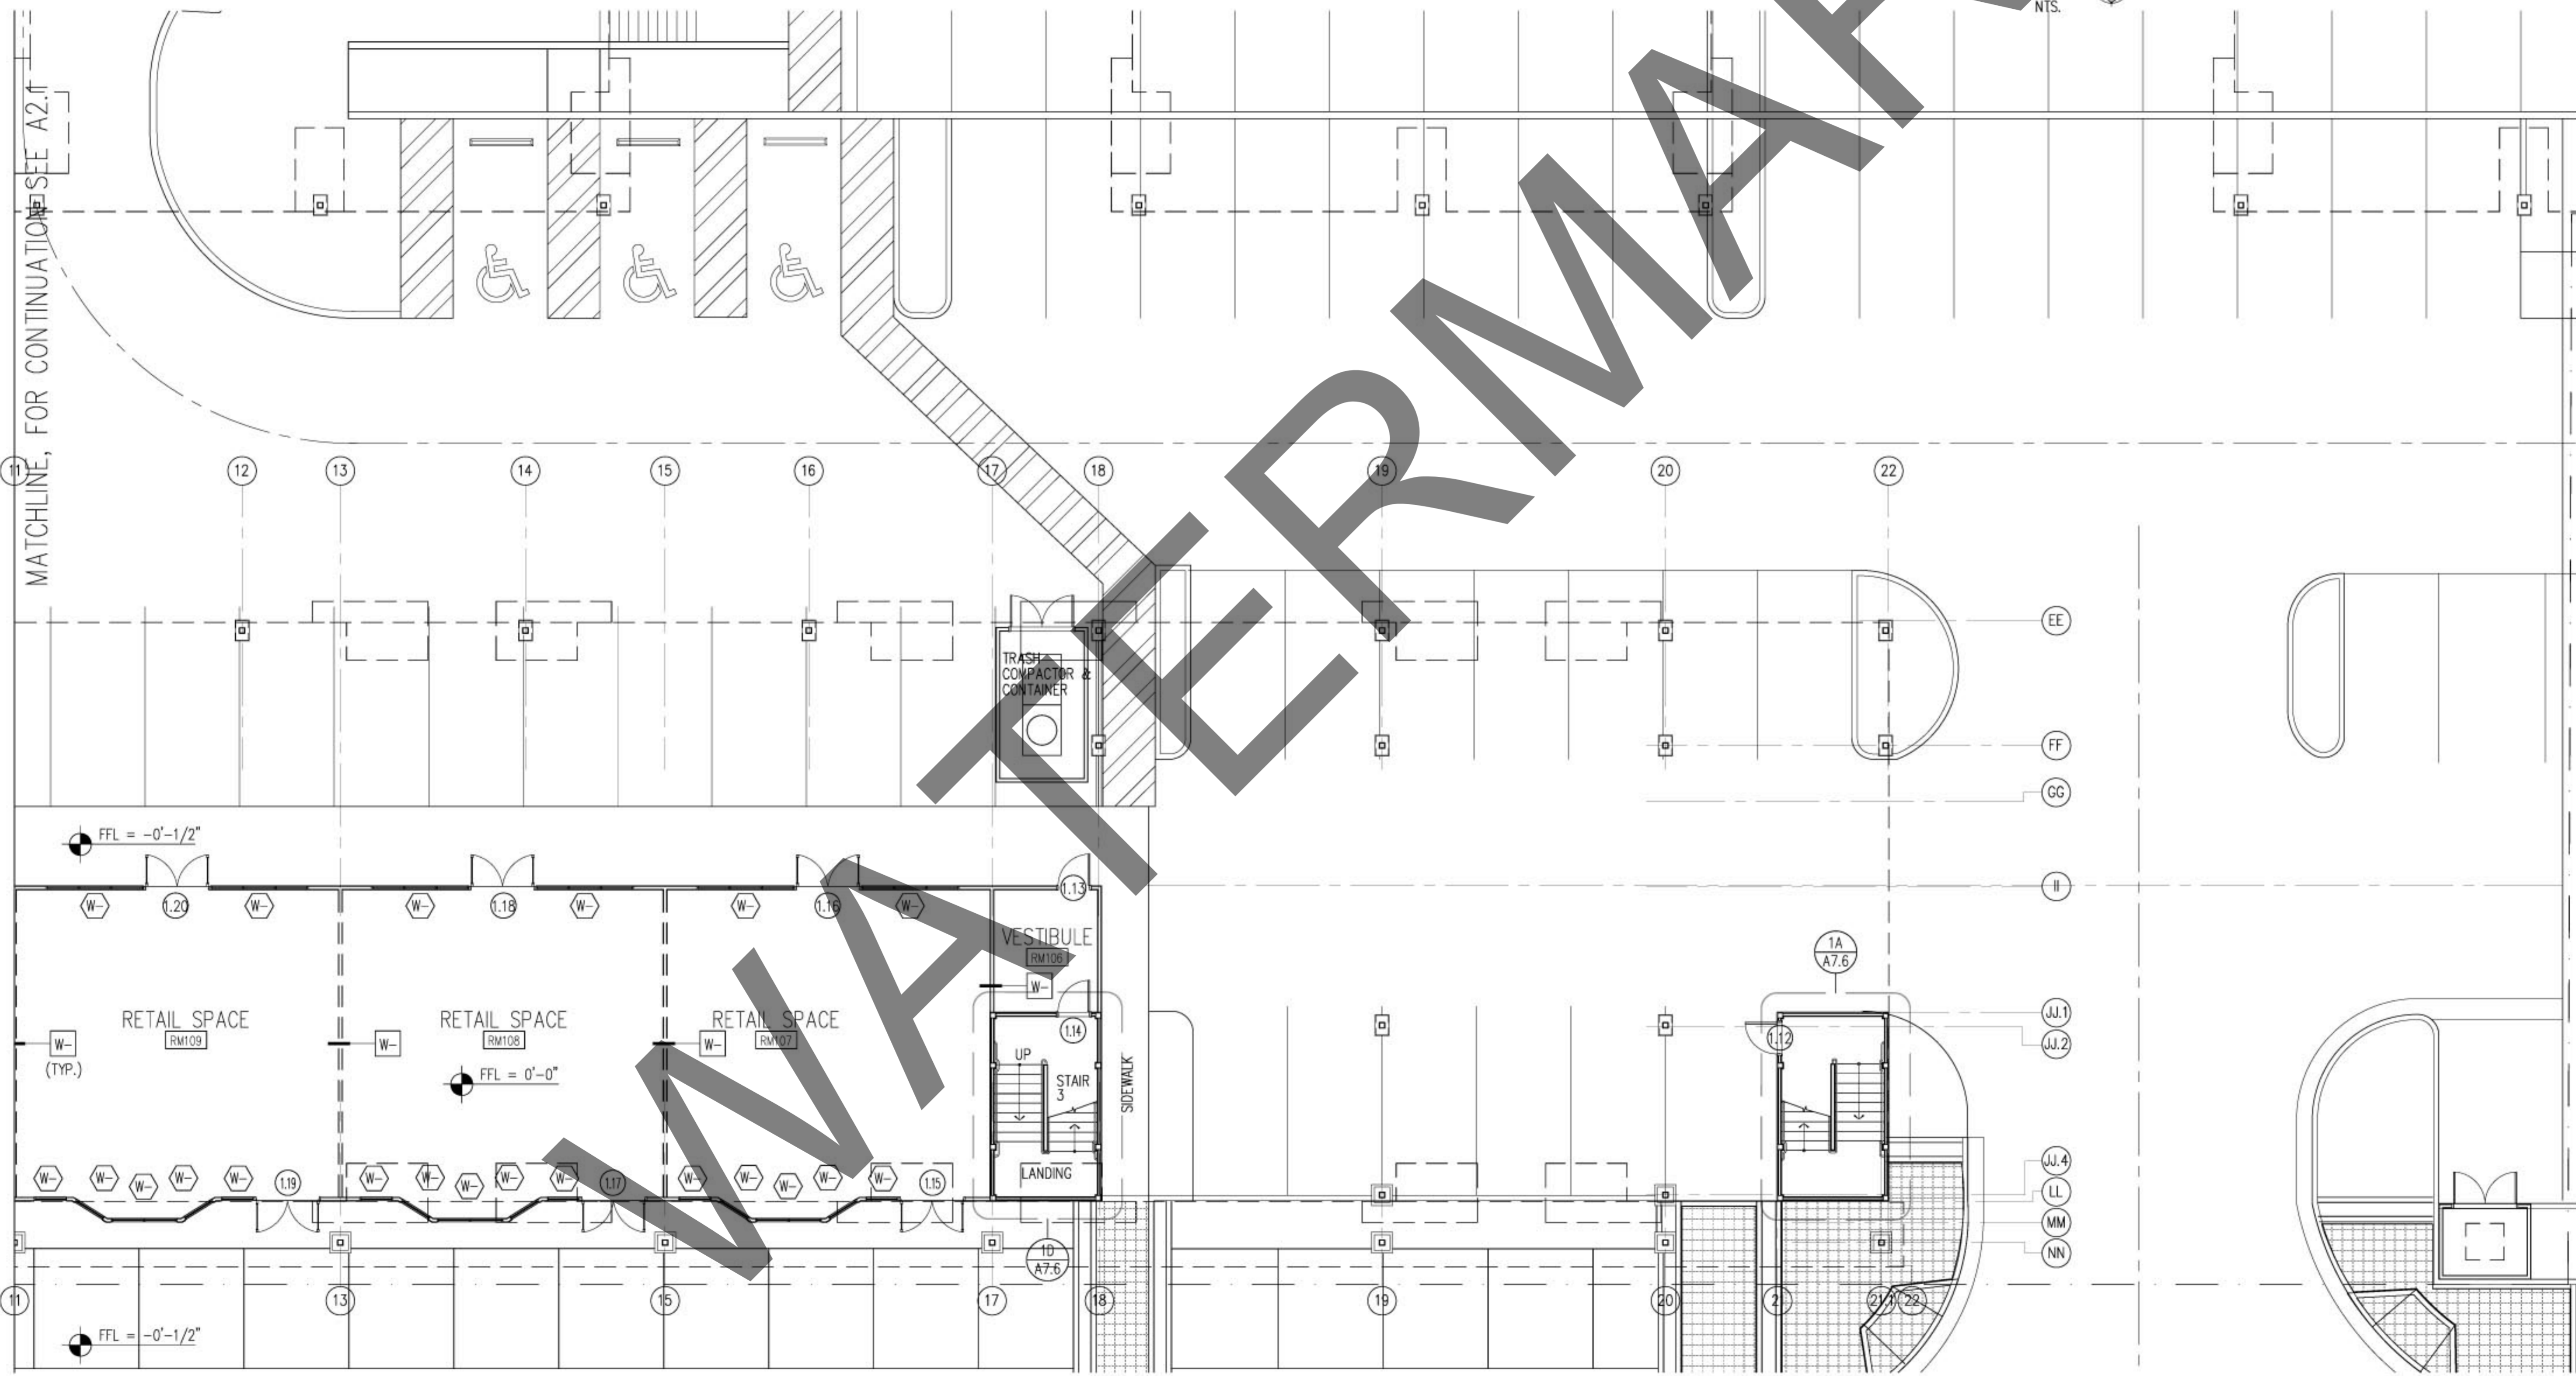


WALL LEGEND

SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION
	15-1.3 2x4 OR 2x6 WOOD STUDS 16" ON CENTER WITH 7/8" CEMENT PLASTER (MEASURED FROM THE FACE OF STUDS) ON THE EXTERIOR SURFACE WITH INTERIOR SURFACE TREATMENT AS REQUIRED FOR INTERIOR WOOD STUD PARTITIONS IN THIS TABLE. PLASTER MIX 1:4 FOR SCRATCH COAT AND 1:5 FOR BROWN COAT, BY VOLUME, CEMENT TO SAND.		ONE LAYER 5/8" TYPE X GYPSUM WALLBOARD OR VENEER BASE APPLIED AT RIGHT ANGLES OR PARALLEL TO EACH SIDE OF 3 5/8" METAL STUDS 24" O.C. TO TOP AND BOTTOM RUNNERS AND INTERMEDIATE STUDS. STAGGER ALL VERTICAL AND HORIZONTAL JOINTS 24" O.C. EACH SIDE AND OPPOSITE SIDES.		8" CONCRETE PARAPET WALL. SEE PLAN FOR HEIGHT & LOCATION, U.N.O.
	ONE LAYER 5/8" TYPE X GYPSUM WALLBOARD OR VENEER BASE APPLIED AT RIGHT ANGLES OR PARALLEL TO EACH SIDE OF 3 5/8" METAL STUDS 24" O.C. TO TOP AND BOTTOM RUNNERS AND INTERMEDIATE STUDS. STAGGER ALL VERTICAL AND HORIZONTAL JOINTS 24" O.C. EACH SIDE AND OPPOSITE SIDES.		ONE LAYER 1/2" PROPRIETARY TYPE X GYPSUM PANELS INSERTED BETWEEN 2 1/2" FLOOR AND CEILING J RUNNERS WITH T SECTION OF 2 1/2" STEEL C-T STUDS BETWEEN PANELS. FACE LAYER 1/2" PROPRIETARY TYPE X GYPSUM WALLBOARD APPLIED PARALLEL TO STUDS WITH VERTICAL JOINTS MIDWAY BETWEEN STUDS AND LAMINATED TO PROPRIETARY GYPSUM PANELS WITH 4" WIDE STRIPS OF TAPING COMPOUND AT WALLBOARD PERIMETER AND VERTICAL CENTERLINE. 1 1/2" TYPE G DRYWALL SCREWS 24" O.C. LOCATED 1 1/2" BACK FROM WALLBOARD EDGES AND AT VERTICAL CENTERLINE.		BASE LAYER 1/2" TYPE X GYPSUM WALLBOARD OR VENEER BASE APPLIED PARALLEL TO EACH SIDE OF 2 1/2" METAL STUDS 24" O.C. WITH 1" TYPE S DRYWALL SCREWS 24" O.C. FACE LAYER 1/2" TYPE X GYPSUM WALLBOARD OR VENEER BASE ON EACH SIDE APPLIED PARALLEL TO STUDS WITH 1 5/8" TYPE S DRYWALL SCREWS 12" O.C. STAGGER JOINTS 24" O.C. EACH LAYER AND SIDE. SOUND TESTED WITH 1 1/2" MINERAL FIBER IN STUD SPACE. (NLB)
	RESILIENT CHANNELS 24" O.C. ATTACHED AT RIGHT ANGLES TO ONE SIDE OF 2 x 4 WOOD STUDS 16" OR 24" O.C. WITH 1 1/4" TYPE S DRYWALL SCREWS. ONE LAYER 5/8" PROPRIETARY TYPE X GYPSUM WALLBOARD OR GYPSUM VENEER BASE APPLIED PARALLEL TO CHANNELS WITH 1" TYPE S DRYWALL SCREWS 12" O.C. END JOINTS BACKBLOCKED WITH RESILIENT CHANNELS. 3" MINERAL FIBER INSULATION, 2.0 OR 2.3 PCF, IN STUD SPACE. OPPOSITE SIDE: ONE LAYER 5/8" PROPRIETARY TYPE X GYPSUM WALLBOARD OR GYPSUM VENEER BASE APPLIED AT RIGHT ANGLES TO STUDS WITH 1 1/2" TYPE W DRYWALL SCREWS 12" O.C. VERTICAL JOINTS STAGGERED 48" ON OPPOSITE SIDES. SOUND TESTED WITH STUDS 16" O.C. AND OPEN FACE OF MINERAL FIBER INSULATION BLANKETS TOWARD RESILIENT CHANNEL-SIDE OF STUD SPACE. (LOAD-BEARING)		OPPOSITE SIDE: BASE LAYER 1/2" PROPRIETARY TYPE X GYPSUM WALLBOARD APPLIED AT RIGHT ANGLES TO STUDS WITH 1" TYPE S DRYWALL SCREWS 24" O.C. FACE LAYER 1/2" PROPRIETARY TYPE X GYPSUM WALLBOARD APPLIED PARALLEL TO STUDS WITH 1 5/8" TYPE S DRYWALL SCREWS 12" O.C. SOUND TESTED WITH 1 7/8" GLASS FIBER INSULATION IN STUD SPACE. (NLB) 12" CONCRETE RETAINING WALL, SEE PLAN FOR HEIGHT & LOCATION, U.N.O.		CHUTE WALL

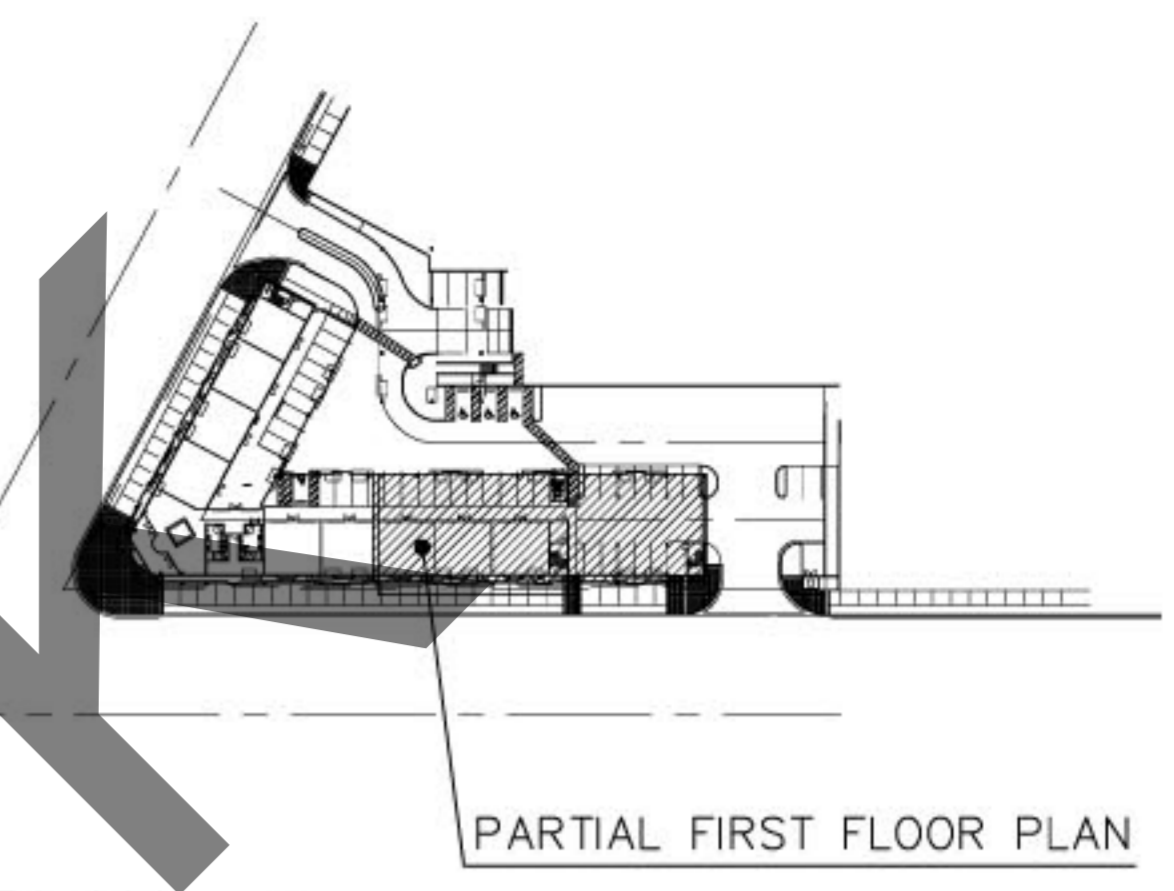

1 PARTIAL FIRST FLOOR PLAN (BLDG 1) NORTH SCALE: 1/8" = 1'-0"

PARTIAL FIRST FLOOR PLAN (BLDG 1)

Revisions:

Date: _____
 Project No.: _____
 Drawn By: JCL
 Check By: DER/FVB
 Sheet No.: _____

A2.1a
 - of -