
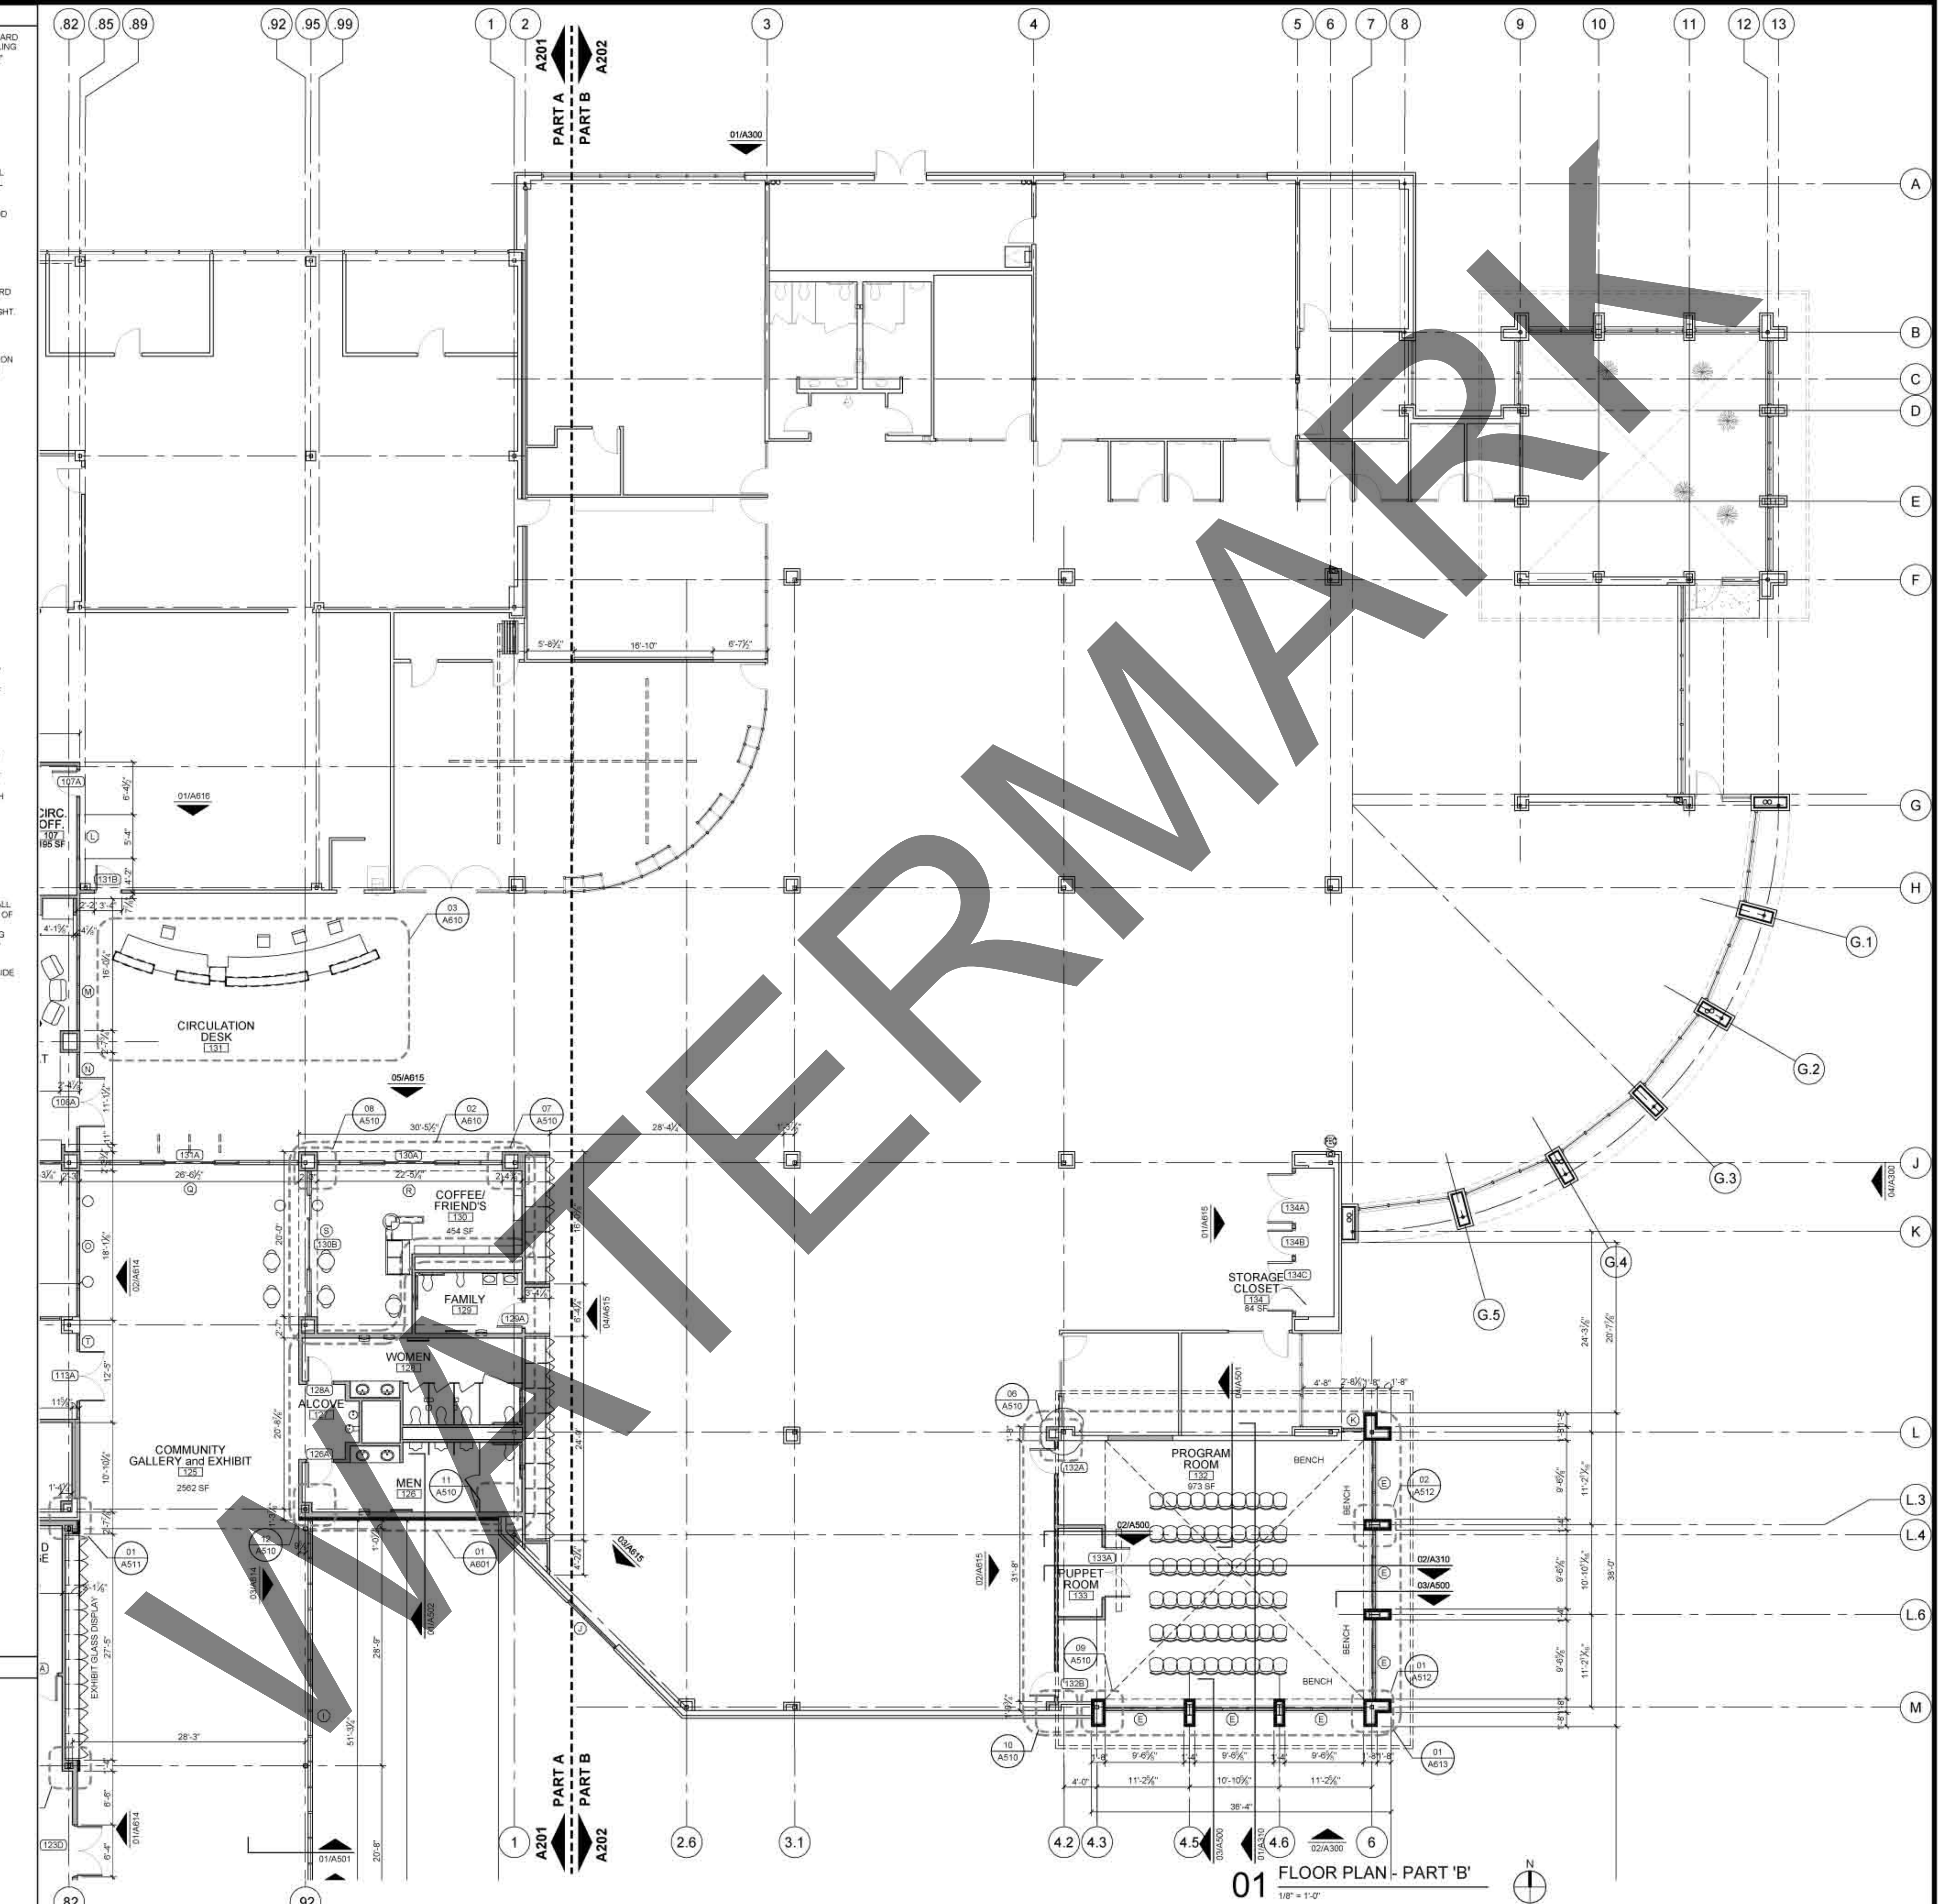


- WALL TYPES**
- (A1) 3/4" METAL STUDS @ 16" O.C. W/ ONE LAYER OF 1/2" GYPSUM BOARD EACH SIDE. EXTEND GYPSUM BOARD 6" ABOVE ADJACENT CEILING HEIGHT. PROVIDE 3/4" METAL STUD DIAGONAL BRACING AT 4'-0" O.C. TO STRUCTURE ABOVE.
  - (A2) SAME EXCEPT W/ SOUND INSULATION
  - (A3) SAME EXCEPT W/ SOUND INSULATION AND 6" METAL STUDS
  - (A4) 3-5/8" METAL STUDS @ 16" O.C. EXTEND STUDS TO 8'-0" A.F.F. PROVIDE ONE LAYER OF 5/8" GYP. BD. EACH SIDE AND TOP.
  - (A5) 6" METAL STUDS @ 16" O.C. WITH ONE LAYER OF 1/2" GYPSUM BOARD EACH SIDE. EXTEND WALL CONSTRUCTION TO STRUCTURAL DECKING ABOVE. PROVIDE FLEXIBLE ACOUSTICAL SEALANT AT EACH SIDE OF INTERSECTION OF WALL AND METAL DECK (AT DATA 102 PROVIDE PLYWOOD OVER GYP. BD. WALL CONSTRUCTION PLYWOOD SHALL EXTEND TO 8'-0" A.F.F. AND SHALL BE PAINTED TO MATCH WALL SURFACE ABOVE. PLYWOOD SHALL START AT TOP OF VINYL BASE).
  - (A6) SAME EXCEPT PROVIDE SOUND INSULATION
  - (A7) SAME EXCEPT 6" METAL STUDS AND SOUND INSULATION
  - (B) 6" METAL STUDS @ 16" O.C. W/ ONE LAYER OF 1/2" GYPSUM BOARD EACH SIDE. EXTEND WALL CONSTRUCTION TO STRUCTURAL DECKING. EXTEND GYP. BD. 6" ABOVE ADJACENT CEILING HEIGHT. PROVIDE SOUND INSULATION.
  - (B1) SAME EXCEPT W/ OUT SOUND INSULATION
  - (B2) SAME EXCEPT W/ 3-5/8" METAL STUDS AND NO SOUND INSULATION
  - (B3) SAME EXCEPT W/ 6" METAL STUDS AND NO SOUND INSULATION
  - (C) 3/4" METAL STUDS @ 16" O.C. W/ ONE LAYER OF 1/2" GYPSUM BOARD ON FINISH SIDE ONLY. EXTEND GYPSUM BOARD 6" ABOVE ADJACENT CEILING HEIGHT. PROVIDE 3/4" METAL STUD DIAGONAL BRACING AT 4'-0" O.C. TO STRUCTURE ABOVE. PROVIDE SOUND INSULATION.
  - (C1) SAME EXCEPT W/OUT SOUND INSULATION
  - (C2) SAME EXCEPT W/ 6" MTL. STUDS WITH SOUND INSULATION
  - (C3) SAME EXCEPT W/ 6" MTL. STUDS AND NO SOUND INSULATION
  - (D) OVERALL WIDTH DIMENSION 2'-0". DOUBLE WALL OF 3/4" METAL STUDS @ 16" O.C. W/ ONE LAYER OF 1/2" GYPSUM BOARD ON FINISH SIDE ONLY. EXTEND GYPSUM BOARD 6" ABOVE CEILING HEIGHT. PROVIDE SOUND INSULATION.
  - (D1) SAME EXCEPT OVERALL WIDTH DIMENSION IS 1'-0"
  - (E) (1 HR RATED PARTITION) 6" METAL STUDS @ 16" O.C. W/ ONE LAYER OF 1/2" TYPE 'X' GYPSUM BOARD EACH SIDE. EXTEND BOTH SIDES OF GYPSUM BOARD TO STRUCTURAL DECKING ABOVE. PROVIDE 3/4" METAL STUD DIAGONAL BRACING AT 4'-0" O.C. TO STRUCTURE ABOVE AS REQUIRED. PROVIDE FIRE RATED SEALANT AT ALL PENETRATIONS AND INTERSECTION OF STRUCTURAL DECKING. PROVIDE SOUND INSULATION.
  - (F) 3-5/8" METAL STUDS @ 16" O.C. PROVIDE ONE LAYER OF 5/8" GYP. BD. EACH SIDE. EXTEND GYP. BD. 6" ABOVE ADJACENT CEILING HEIGHT. PROVIDE 3-5/8" METAL STUD DIAGONAL BRACING AT 4'-0" O.C. TO STRUCTURE ABOVE. PROVIDE SOUND INSULATION. PROVIDE 1/2" PLYWOOD AS REQUIRED (ON ALL WALL SURFACES FOR ELECTRICAL, DATA & PHONE EQUIPMENT ROOMS). COORDINATE W/ ELECTRICAL DRAWINGS. PLYWOOD SHALL EXTEND TO 8'-4" A.F.F. AND SHALL BE PAINTED TO MATCH WALL SURFACE ABOVE. PLYWOOD SHALL START AT TOP OF VINYL BASE.
  - (F1) SAME EXCEPT W/ 6" MTL. STUDS. W/ SOUND INSULATION.
  - (F2) SAME EXCEPT WITHOUT SOUND INSULATION.
  - (F3) SAME AS F1 EXCEPT WITHOUT SOUND INSULATION.
  - (G) DASHED LINE INDICATES EXISTING CMU WALL TO REMAIN. PROVIDE NEW 3/4" METAL STUDS AT 16" O.C. METAL STUDS SHALL BE PLACED 2" FROM FACE OF CMU WALL. PROVIDE ONE LAYER OF 1/2" GYP. BD. PROVIDE SOUND INSULATION WITHIN NEW WALL CONSTRUCTION. EXTEND GYP. BD. 6" ABOVE ADJACENT CEILING HEIGHT. PROVIDE 3/4" METAL STUD DIAGONAL BRACING AT 4'-0" O.C. AS REQUIRED.
  - (G1) SAME EXCEPT EXTEND NEW WALL CONSTRUCTION TO UNDERSIDE OF ROOF DECK.

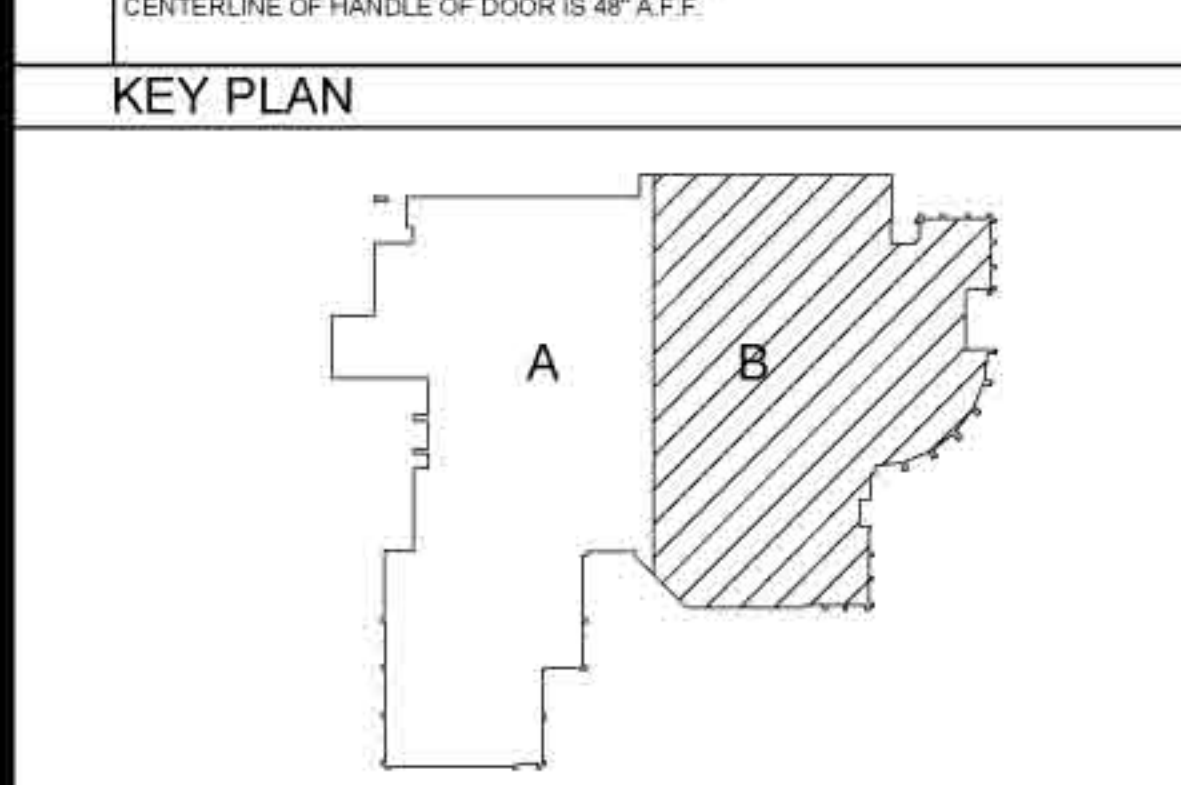

**01 FLOOR PLAN - PART 'B'**  
1/8" = 1'-0"

JOB NO.	28000
Issue Date	06/19/2009
Drawn By	DZ
Checked By	TB
SHEET NO.	A202